ICAST 2009
V1

Sponsored by the
AMERICAN SPORTFISHING ASSOCIATION

July 15 - 17, 2009

WEST BUILDING
ORANGE COUNTY CONVENTION CENTER
ORLANDO, FLORIDA

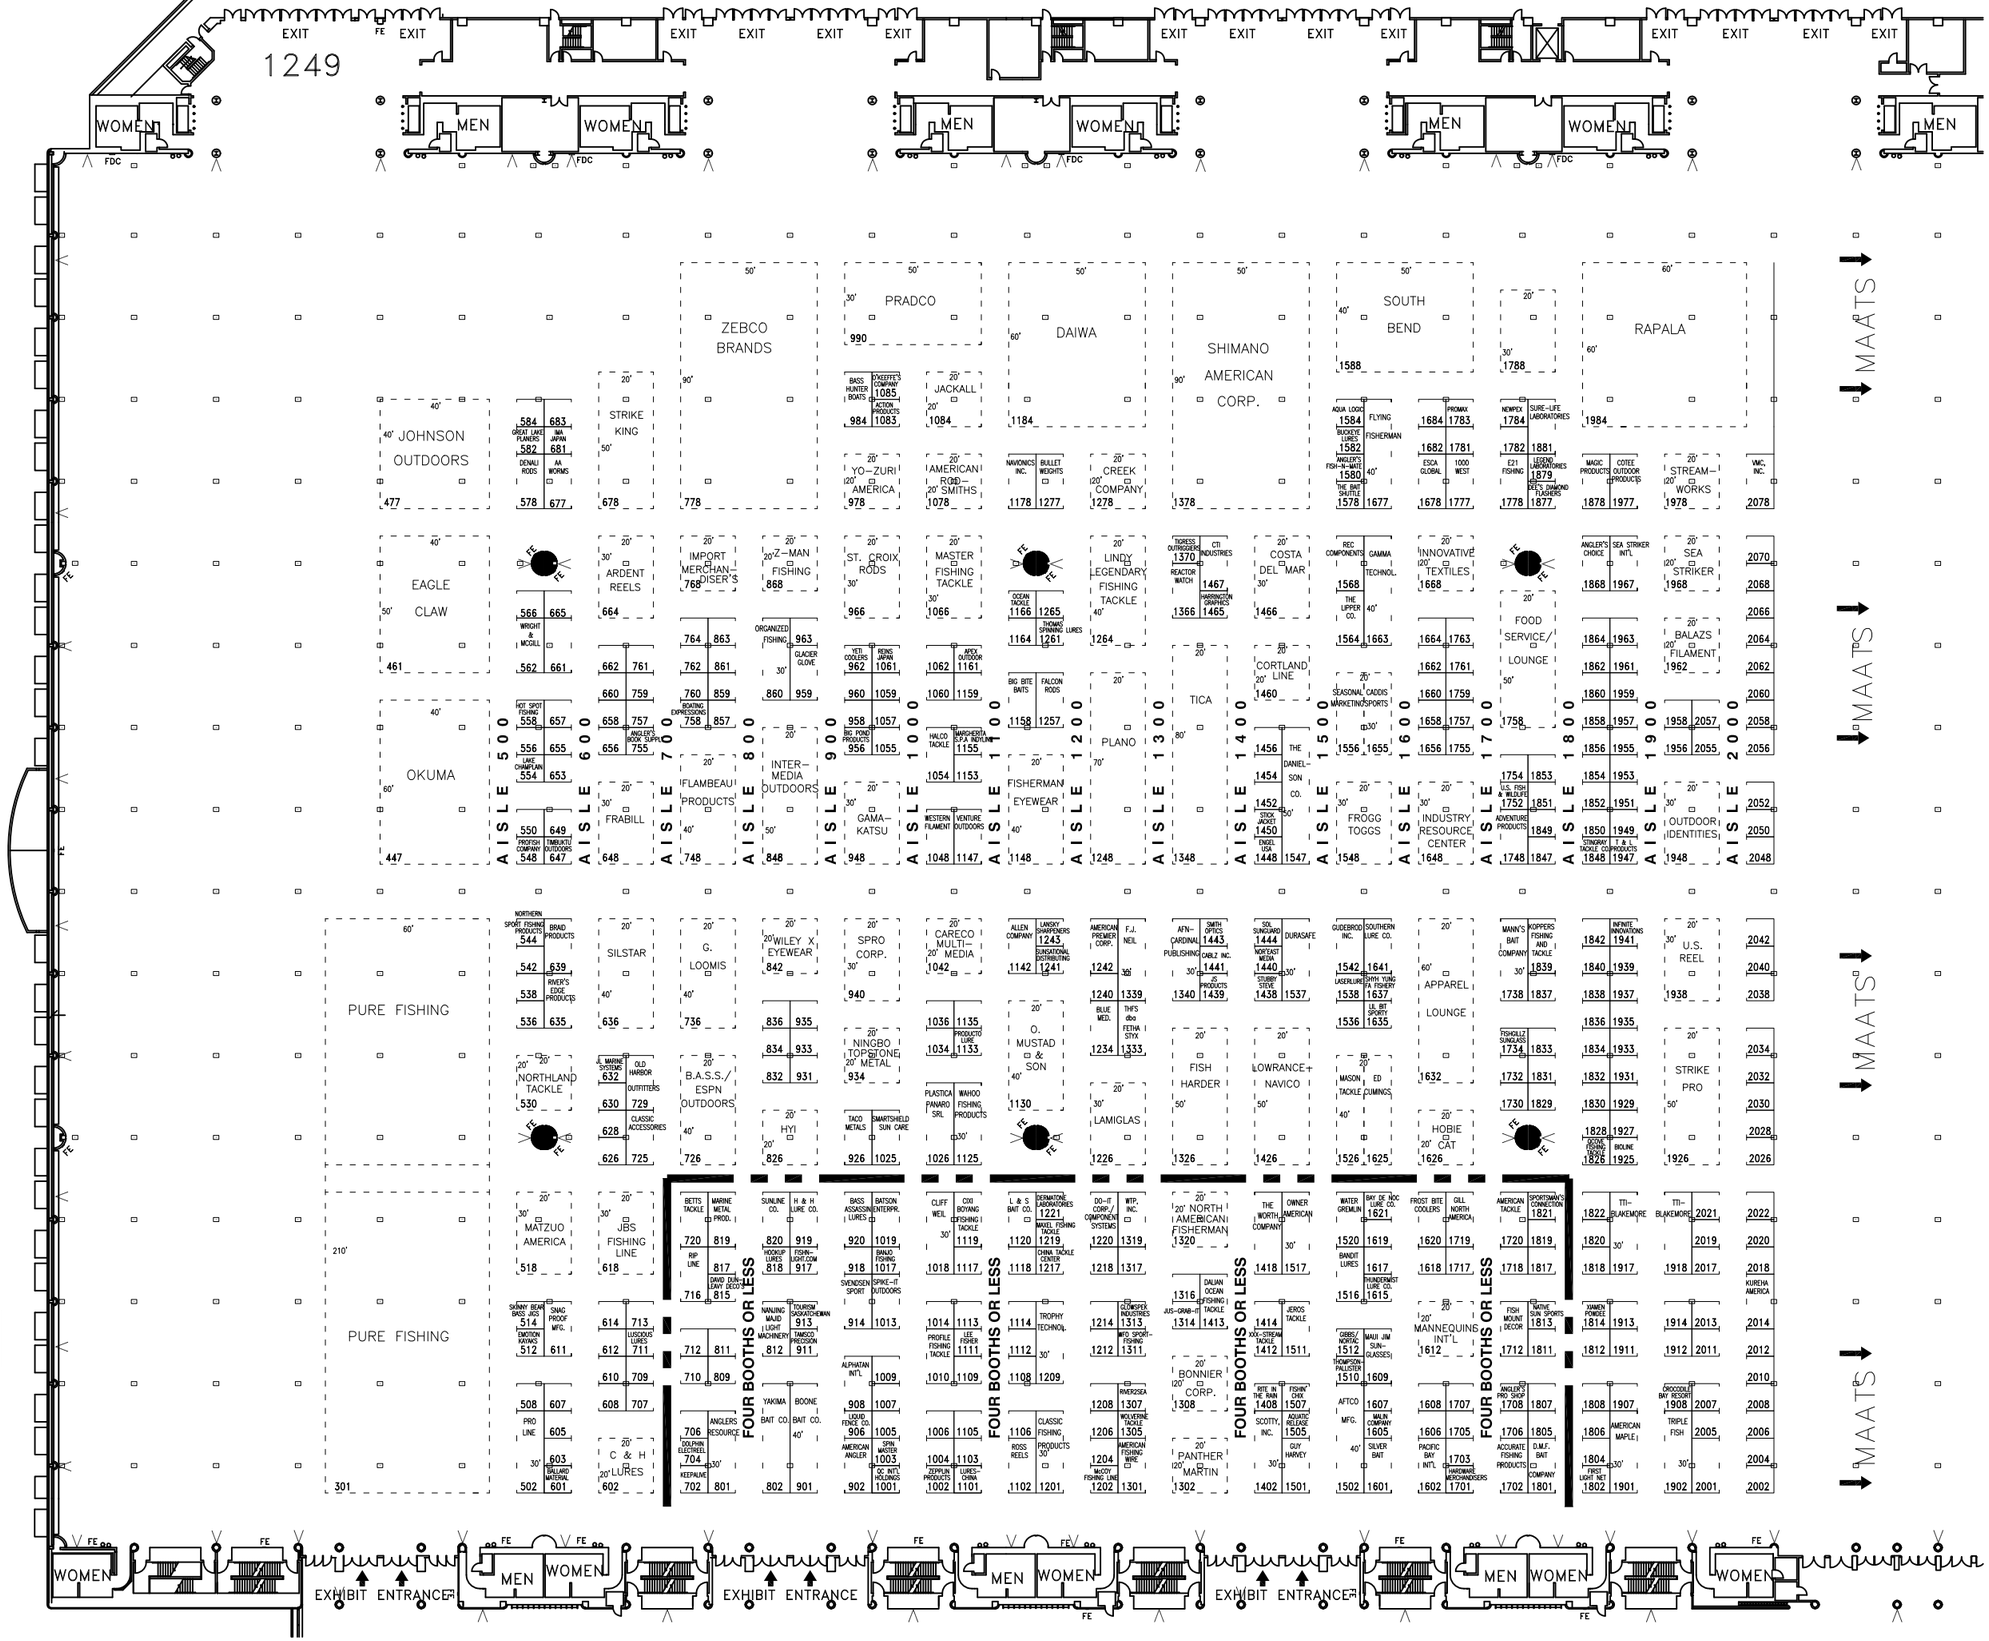

GENERAL INFORMATION

□ = UTILITY FLOOR PORTS CONTAINING COMBINATION 20 AMP, 120 V & 20 AMP, 208 V 1 PHASE POWER OUTLET 100 AMP – 120/208 V 3 PHASE 4 W WATER AND DRAIN, COMP. AIR 90 PSI

FE = FIRE EXTINGUISHER

FDC = FIRE DEPT. CABINET

< = FIRE STROBES

● = 9' DIAMETER COLUMN

CEILING HEIGHT: 40 FT. MINIMUM

- - - INDICATES AREA OF FOUR BOOTHS OR LESS

0 5 10 20 30 40 50

W S N E

BOOTHS ARE 10' x 10' OR 10' x 20' UNLESS OTHERWISE INDICATED

AS OF MARCH 13, 2009

EXPOSITION MANAGEMENT, INC

10425 OLD OLIVE ST. RD. - SUITE 103
ST. LOUIS, MO 63141-5940
(314) 994-9640